


This document, together with the concepts and designs presented herein, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kinney-Horn and Associates, Inc. shall be without liability to Kinney-Horn and Associates, Inc.

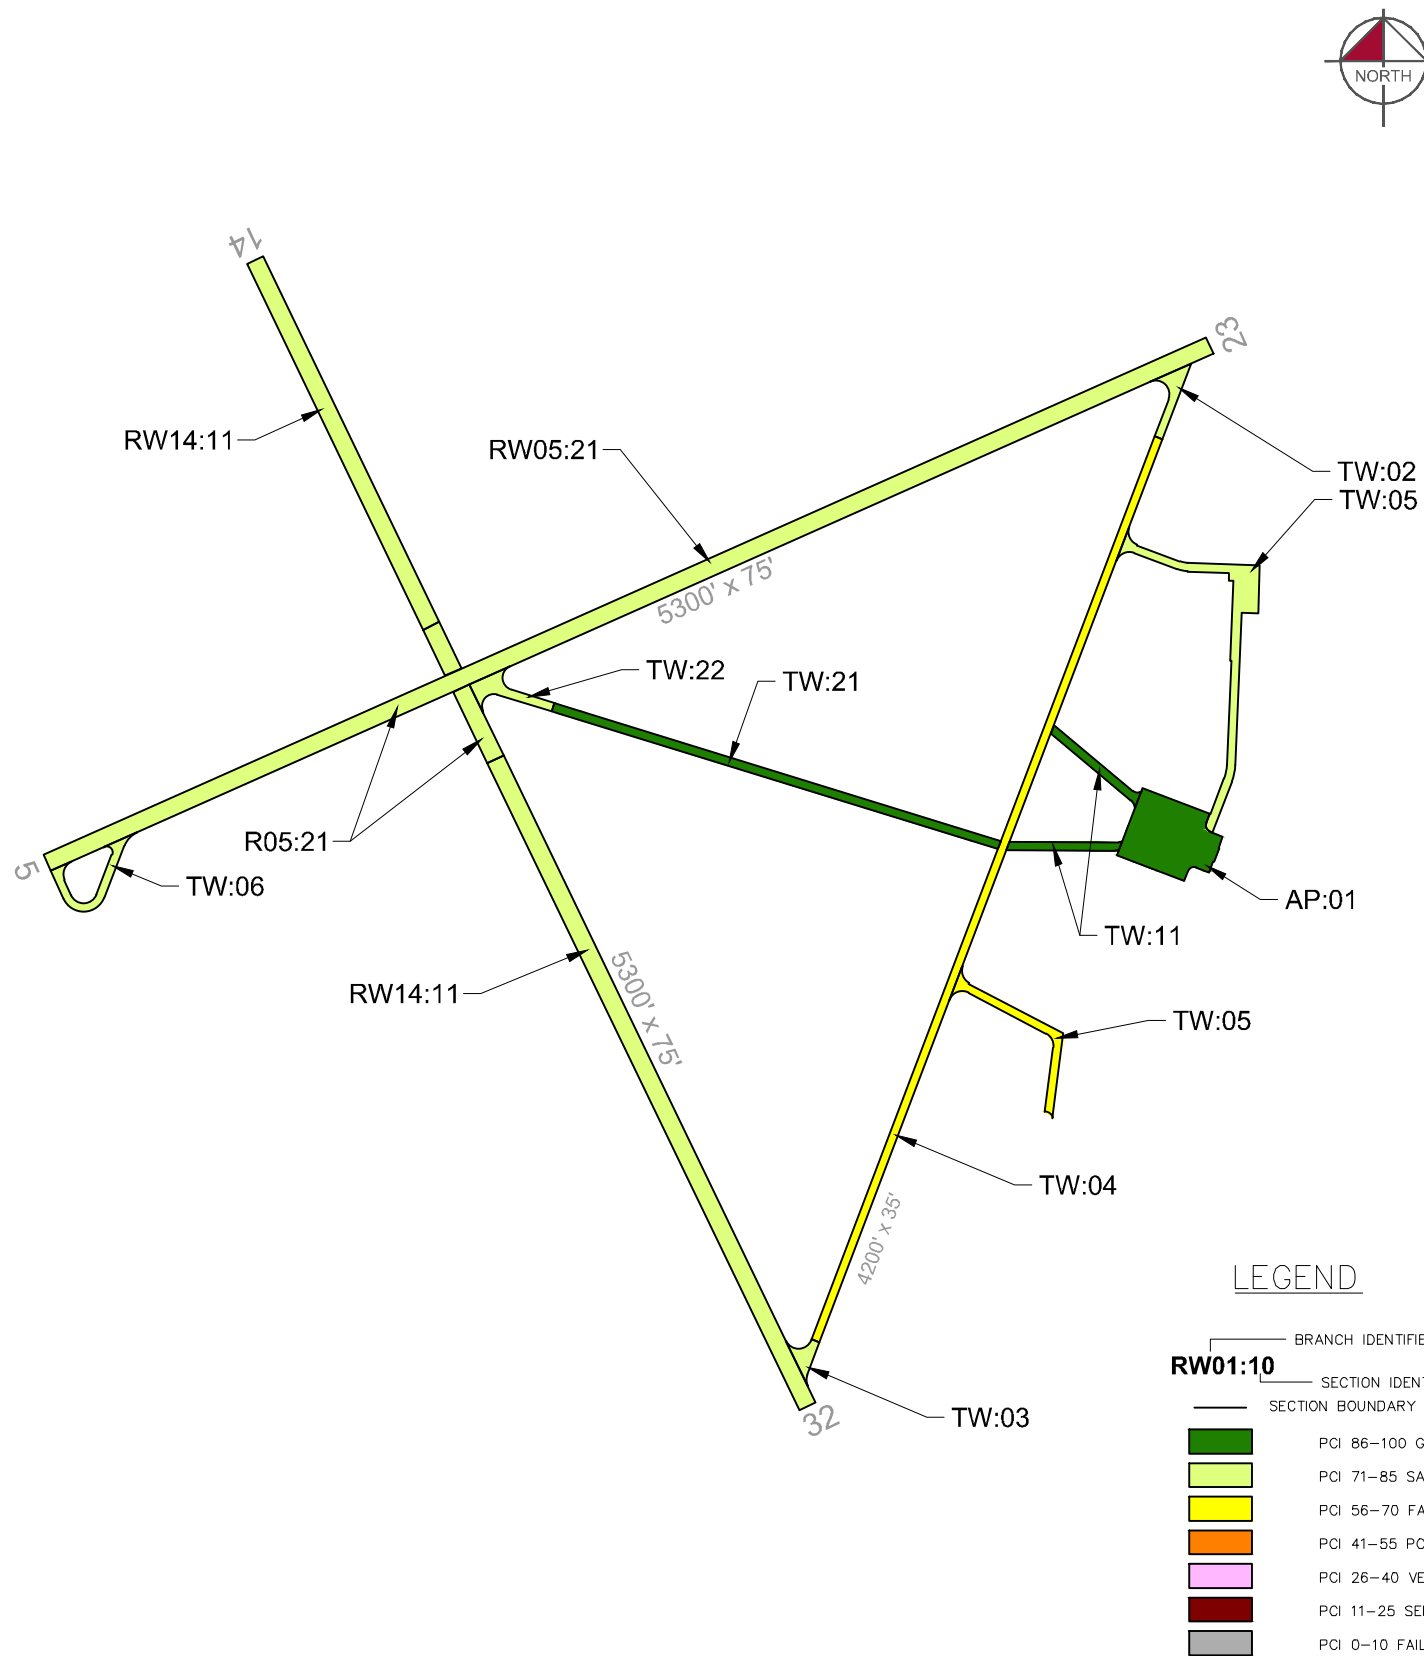

CURRENT 2021 PAVEMENT CONDITION INDEX

Branch ID	Section ID	Branch Name	Surface Type	Section Area (SF)	Approx. Age at Inspection	Last Major Work Date	Last Inspection Date	Pavement Condition Index	PCI Category
AP	01	Apron	APC	102,000	3	1/1/2019	1/1/2019	100	Good
RW05	21	Runway 05-23	AC	437,850	14.4	8/1/2007	9/9/2021	74	Satisfactory
RW14	11	Runway 14-32	AAC	397,500	7.5	7/1/2014	9/9/2021	85	Satisfactory
TW	02	Taxiway	AC	15,205	14.4	8/1/2007	9/9/2021	77	Satisfactory
TW	03	Taxiway	AAC	20,055	7.5	7/1/2014	9/9/2021	83	Satisfactory
TW	04	Taxiway	AC	140,863	30.4	7/31/1991	9/9/2021	65	Fair
TW	05	Taxiway	AC	104,013	21.3	9/15/2000	9/9/2021	62	Fair
TW	06	Taxiway	AC	19,600	14.4	8/1/2007	9/9/2021	82	Satisfactory
TW	11	Taxiway	AAC	34,125	7.5	7/1/2014	9/9/2021	88	Good
TW	21	Taxiway	AAC	92,000	7.5	7/1/2014	9/9/2021	92	Good
TW	22	Taxiway	AC	138,705	14.4	8/1/2007	9/9/2021	81	Satisfactory

AIRFIELD PAVEMENT WORK HISTORY

1. NTL'S REPORT JULY 1969 SHOWS THAT THE ASPHALTIC CONCRETE HAS COMPLETELY DETERIORATED AND THE BASE IS 'G-1' DUE TO PUMPING ACTION WITH CLAY SUBGRADE ON RUNWAY 4-22; ASSUME THE SAME HOLDS TRUE FOR OTHER PVMTS.
2. ADAP-01, 1980, REHABILITATE RUNWAY 4/22 AND TAXIWAY.
3. AIP-001-1984, REHABILITATE RUNWAY 13/31, OVERLAY RUNWAY 4/22.
4. AIP-002-1990, REMOVED AND ABANDON 75'-WIDE OLD PAVEMENT ALONG RUNWAY 13/31.
5. AIP-003-1991, CONVERT RUNWAY 18/36 TO TAXIWAY C (TW:04), 35' WIDE WITH 20' WIDE SHOULDERS.
6. AIP-004-2000, CONSTRUCT HANGAR ACCESS TAXIWAY; REPLACE SELECT CONCRETE APRON PANELS.
7. AIP-005-2003, CRACK SEAL, FOG SEAL, AND REMARK (RW14:01,RW14:11,TW:01,TW:02,TW:04); REPLACE SELECT CONCRETE PANELS (AP:01).
8. AIP-008-2007, RECONSTRUCT RUNWAY & TRANSITIONS (RW05:21); CONSTRUCT TURNAROUND (TW:06); CRACK SEAL OTHER PVMTS.
9. AIP-010-2012, CRACK SEAL, FOG SEAL, AND REMARK (RW14:21,TW:04,TW:05,TW:06).
10. AIP-011-2014, RECONSTRUCT RUNWAY 14/32 (RW14:11), TAXIWAYS A & B (TW:11,TW:21).
11. AIP-013-2018, 3" P-401 ASPHALT OVERLAY (AP:01).

Runway



RW11-50: L&T Cracking



RW21-41: L&T Cracking

Taxiway



TW05-02: Overview, L&T Cracking



TW03-01: Overview



TW02-01: Overview, Patching



TW05-10: L&T Cracking

Re-Inspection Report

MDT SASP 2021

Generated Date 1/3/2022

Page 1 of 12

Network: CTB **Name:** Cut Bank International Airport

Branch: AP **Name:** Apron **Use:** APRON **Area:** 102,000 SqFt

Section: 01 of 1 **From:** ENTIRE APRON **To:** **Last Const.:** 1/1/2019

Surface: APC **Family:** DEFAULT **Zone:** CUTB **Category:** P **Rank:** P

Area: 102,000 SqFt **Length:** 300 Ft **Width:** 300 Ft

Slabs: 680 **Slab Length:** 15 Ft **Slab Width:** 10 Ft **Joint Length:** 14,400 Ft

Shoulder: **Street Type:** PCA **Grade:** 0 **Lanes:** 0

Section Comments:

Work Date: 7/30/1942 **Work Type:** New Construction - Initial **Code:** NU-IN **Is Major M&R:** True

Work Date: 1/1/2019 **Work Type:** Overlay-Asphalt **Code:** OL-AC **Is Major M&R:** True

Last Insp. Date: 12/6/2012 **TotalSamples:** 34 **Surveyed:** 10

Conditions: PCI: 28 **NOTE: *** Pre-Construction PCI *****

Inspection Comments:

Sample Number: 11 **Type:** R **Area:** 20.00 Slabs **PCI:** 32

Sample Comments:

- 65 JOINT SEAL DAMAGE H 20.00 Slabs
- 71 FAULTING L 2.00 Slabs
- 74 JOINT SPALLING L 8.00 Slabs
- 74 JOINT SPALLING M 3.00 Slabs
- 74 JOINT SPALLING H 8.00 Slabs
- 75 CORNER SPALLING L 5.00 Slabs
- 75 CORNER SPALLING M 2.00 Slabs
- 75 CORNER SPALLING H 3.00 Slabs

Sample Number: 14 **Type:** R **Area:** 20.00 Slabs **PCI:** 13

Sample Comments:

- 63 LINEAR CRACKING L 3.00 Slabs
- 65 JOINT SEAL DAMAGE H 20.00 Slabs
- 71 FAULTING L 5.00 Slabs
- 71 FAULTING M 1.00 Slabs
- 74 JOINT SPALLING L 1.00 Slabs
- 74 JOINT SPALLING M 4.00 Slabs
- 74 JOINT SPALLING H 15.00 Slabs
- 75 CORNER SPALLING L 5.00 Slabs
- 75 CORNER SPALLING M 4.00 Slabs
- 75 CORNER SPALLING H 11.00 Slabs

Sample Number: 17 **Type:** R **Area:** 20.00 Slabs **PCI:** 31

Sample Comments:

- 65 JOINT SEAL DAMAGE H 20.00 Slabs
- 66 SMALL PATCH L 4.00 Slabs
- 74 JOINT SPALLING L 4.00 Slabs
- 74 JOINT SPALLING M 4.00 Slabs
- 74 JOINT SPALLING M 12.00 Slabs
- 75 CORNER SPALLING L 3.00 Slabs
- 75 CORNER SPALLING M 11.00 Slabs
- 75 CORNER SPALLING H 6.00 Slabs

Sample Number: 2 **Type:** R **Area:** 20.00 Slabs **PCI:** 44

Sample Comments:

- 65 JOINT SEAL DAMAGE H 20.00 Slabs
- 74 JOINT SPALLING L 4.00 Slabs
- 74 JOINT SPALLING M 10.00 Slabs
- 74 JOINT SPALLING H 6.00 Slabs

Sample Number: 20 **Type:** R **Area:** 20.00 Slabs **PCI:** 13

Sample Comments:

63	LINEAR CRACKING	M	1.00	Slabs
65	JOINT SEAL DAMAGE	H	20.00	Slabs
66	SMALL PATCH	L	3.00	Slabs
71	FAULTING	L	2.00	Slabs
74	JOINT SPALLING	L	7.00	Slabs
74	JOINT SPALLING	M	5.00	Slabs
74	JOINT SPALLING	H	8.00	Slabs
75	CORNER SPALLING	L	3.00	Slabs
75	CORNER SPALLING	M	3.00	Slabs
75	CORNER SPALLING	H	14.00	Slabs

Sample Number: 23 **Type:** R **Area:** 20.00 Slabs **PCI:** 31

Sample Comments:

65	JOINT SEAL DAMAGE	H	20.00	Slabs
71	FAULTING	L	2.00	Slabs
74	JOINT SPALLING	L	10.00	Slabs
74	JOINT SPALLING	M	8.00	Slabs
74	JOINT SPALLING	H	2.00	Slabs
75	CORNER SPALLING	L	10.00	Slabs
75	CORNER SPALLING	M	8.00	Slabs
75	CORNER SPALLING	H	2.00	Slabs

Sample Number: 26 **Type:** R **Area:** 20.00 Slabs **PCI:** 14

Sample Comments:

65	JOINT SEAL DAMAGE	H	20.00	Slabs
71	FAULTING	L	1.00	Slabs
74	JOINT SPALLING	L	2.00	Slabs
74	JOINT SPALLING	H	16.00	Slabs
75	CORNER SPALLING	L	2.00	Slabs
75	CORNER SPALLING	M	4.00	Slabs
75	CORNER SPALLING	H	12.00	Slabs

Sample Number: 29 **Type:** R **Area:** 20.00 Slabs **PCI:** 45

Sample Comments:

65	JOINT SEAL DAMAGE	H	20.00	Slabs
66	SMALL PATCH	L	3.00	Slabs
71	FAULTING	L	2.00	Slabs
74	JOINT SPALLING	L	8.00	Slabs
74	JOINT SPALLING	M	9.00	Slabs
75	CORNER SPALLING	L	5.00	Slabs
75	CORNER SPALLING	M	4.00	Slabs
75	CORNER SPALLING	M	3.00	Slabs

Sample Number: 5 **Type:** R **Area:** 20.00 Slabs **PCI:** 38

Sample Comments:

65	JOINT SEAL DAMAGE	H	20.00	Slabs
71	FAULTING	L	5.00	Slabs
74	JOINT SPALLING	L	3.00	Slabs
74	JOINT SPALLING	M	3.00	Slabs
74	JOINT SPALLING	M	10.00	Slabs
75	CORNER SPALLING	L	3.00	Slabs
75	CORNER SPALLING	M	7.00	Slabs
75	CORNER SPALLING	M	5.00	Slabs

Sample Number: 8 **Type:** R **Area:** 20.00 Slabs **PCI:** 18

Sample Comments:

65	JOINT SEAL DAMAGE	H	20.00	Slabs
71	FAULTING	L	2.00	Slabs
74	JOINT SPALLING	L	6.00	Slabs
74	JOINT SPALLING	M	2.00	Slabs
74	JOINT SPALLING	H	8.00	Slabs
75	CORNER SPALLING	L	4.00	Slabs
75	CORNER SPALLING	M	4.00	Slabs
75	CORNER SPALLING	H	9.00	Slabs

Network:	CTB		Name:	Cut Bank International Airport					
Branch:	RW05	Name:	Runway 05-23	Use:	RUNWAY	Area:	437,850 SqFt		
Section:	21	of	1	From:	STA. 12+00 RWY 5-23	To:	STA. 65+00 RWY 5-23	Last Const.:	8/1/2007
Surface:	AC	Family:	DEFAULT	Zone:	CUTB	Category:	D	Rank:	P
Area:	437,850 SqFt	Length:	5,785 Ft	Width:	75 Ft				
Slabs:		Slab Length:	Ft	Slab Width:	Ft	Joint Length:	Ft		
Shoulder:		Street Type:	ACM	Grade:	0	Lanes:	0		
Section Comments:									
Work Date:	8/1/2007	Work Type:	New Construction - Initial		Code:	NU-IN	Is Major M&R:	True	
Last Insp. Date:	9/9/2021	TotalSamples:	89	Surveyed:	7				
Conditions:	PCI: 74								
Inspection Comments:									
Sample Number:	02	Type:	R	Area:	4875.00 SqFt	PCI:	66		
Sample Comments:									
48	L & T CR	L	165.00	Ft					
48	L & T CR	M	104.00	Ft					
50	PATCHING	L	30.00	SqFt					
57	WEATHERING	L	4387.00	SqFt					
57	WEATHERING	M	488.00	SqFt					
Sample Number:	15	Type:	R	Area:	4875.00 SqFt	PCI:	77		
Sample Comments:									
48	L & T CR	L	210.00	Ft					
57	WEATHERING	L	4387.00	SqFt					
57	WEATHERING	M	488.00	SqFt					
Sample Number:	28	Type:	R	Area:	4878.00 SqFt	PCI:	84		
Sample Comments:									
48	L & T CR	L	65.00	Ft					
57	WEATHERING	L	4390.00	SqFt					
57	WEATHERING	M	488.00	SqFt					
Sample Number:	41	Type:	R	Area:	4875.00 SqFt	PCI:	73		
Sample Comments:									
48	L & T CR	L	145.00	Ft					
48	L & T CR	M	61.00	Ft					
57	WEATHERING	L	4387.00	SqFt					
57	WEATHERING	M	488.00	SqFt					
Sample Number:	54	Type:	R	Area:	4875.00 SqFt	PCI:	74		
Sample Comments:									
48	L & T CR	L	155.00	Ft					
48	L & T CR	M	48.00	Ft					
57	WEATHERING	L	4387.00	SqFt					
57	WEATHERING	M	488.00	SqFt					
Sample Number:	67	Type:	R	Area:	4875.00 SqFt	PCI:	77		
Sample Comments:									
48	L & T CR	L	205.00	Ft					
57	WEATHERING	L	4387.00	SqFt					
57	WEATHERING	M	488.00	SqFt					
Sample Number:	80	Type:	R	Area:	4875.00 SqFt	PCI:	70		
Sample Comments:									
48	L & T CR	L	248.00	Ft					
48	L & T CR	M	20.00	Ft					
57	WEATHERING	L	4387.00	SqFt					
57	WEATHERING	M	488.00	SqFt					

Network:	CTB		Name:	Cut Bank International Airport					
Branch:	RW14	Name:	RUNWAY 14-32	Use:	RUNWAY	Area:	397,500 SqFt		
Section:	11	of	1	From:	STA 0+00 R/W 4-22	To:	STA 53+00 R/W 4-22	Last Const.:	7/1/2014
Surface:	AAC	Family:	DEFAULT	Zone:	CUTB	Category:	E	Rank:	P
Area:	397,500 SqFt	Length:	5,300 Ft	Width:	75 Ft				
Slabs:		Slab Length:	Ft	Slab Width:	Ft	Joint Length:	Ft		
Shoulder:		Street Type:	ACM	Grade:	0	Lanes:	0		
Section Comments:									
Work Date:	8/1/1945	Work Type:	New Construction - AC		Code:	NC-AC	Is Major M&R:	True	
Work Date:	8/1/1984	Work Type:	OVERLAY-AC GLOBAL		Code:	OL-AT	Is Major M&R:	False	
Work Date:	8/1/1984	Work Type:	Overlay - AC Structural		Code:	OL-AS	Is Major M&R:	True	
Work Date:	7/31/1991	Work Type:	Surface Course - Porous Friction		Code:	SU-PF	Is Major M&R:	True	
Work Date:	7/1/2014	Work Type:	AC- Mill and Overlay		Code:	AC-MO	Is Major M&R:	True	
Last Insp. Date:	9/9/2021	TotalSamples:	81	Surveyed:	8				
Conditions:	PCI:	85							
Inspection Comments:									
Sample Number:	03	Type:	R	Area:	4878.00 SqFt	PCI:	85		
Sample Comments:									
48	L & T CR	L	143.00 Ft						
57	WEATHERING	L	4878.00 SqFt						
Sample Number:	08	Type:	R	Area:	4878.00 SqFt	PCI:	82		
Sample Comments:									
48	L & T CR	L	195.00 Ft						
57	WEATHERING	L	4878.00 SqFt						
Sample Number:	25	Type:	R	Area:	4878.00 SqFt	PCI:	87		
Sample Comments:									
48	L & T CR	L	115.00 Ft						
57	WEATHERING	L	4878.00 SqFt						
Sample Number:	28	Type:	R	Area:	4875.00 SqFt	PCI:	81		
Sample Comments:									
48	L & T CR	L	222.00 Ft						
57	WEATHERING	L	4875.00 SqFt						
Sample Number:	45	Type:	R	Area:	4878.00 SqFt	PCI:	86		
Sample Comments:									
48	L & T CR	L	130.00 Ft						
57	WEATHERING	L	4878.00 SqFt						
Sample Number:	49	Type:	R	Area:	4878.00 SqFt	PCI:	86		
Sample Comments:									
48	L & T CR	L	129.00 Ft						
57	WEATHERING	L	4878.00 SqFt						
Sample Number:	55	Type:	R	Area:	4878.00 SqFt	PCI:	89		
Sample Comments:									
48	L & T CR	L	65.00 Ft						
57	WEATHERING	L	4878.00 SqFt						
Sample Number:	65	Type:	R	Area:	4878.00 SqFt	PCI:	86		
Sample Comments:									
48	L & T CR	L	130.00 Ft						
57	WEATHERING	L	4878.00 SqFt						

Network:	CTB		Name:	Cut Bank International Airport			
Branch:	TW	Name:	Taxiway	Use:	TAXIWAY	Area:	564,566 SqFt
Section:	02	of 8	From:	-	To:	-	Last Const.: 8/1/2007
Surface:	AC	Family:	DEFAULT	Zone:		Category:	Rank: P
Area:	15,205 SqFt	Length:	437 Ft	Width:	35 Ft		
Slabs:		Slab Length:	Ft	Slab Width:	Ft	Joint Length:	Ft
Shoulder:		Street Type:		Grade:	0	Lanes:	0
Section Comments:							
Work Date:	8/1/2007	Work Type:	New Construction - Initial	Code:	NU-IN	Is Major M&R:	True
Last Insp. Date:	9/9/2021	TotalSamples:	3	Surveyed:	3		
Conditions:	PCI: 77						
Inspection Comments:							
Sample Number:	01	Type:	R	Area:	3500.00 SqFt	PCI:	67
Sample Comments:							
48	L & T CR	L	223.00 Ft				
48	L & T CR	M	36.00 Ft				
57	WEATHERING	L	3150.00 SqFt				
57	WEATHERING	M	350.00 SqFt				
Sample Number:	02	Type:	R	Area:	3652.00 SqFt	PCI:	76
Sample Comments:							
48	L & T CR	L	90.00 Ft				
50	PATCHING	L	150.00 SqFt				
57	WEATHERING	L	3152.00 SqFt				
57	WEATHERING	M	350.00 SqFt				
Sample Number:	03	Type:	R	Area:	8054.00 SqFt	PCI:	81
Sample Comments:							
48	L & T CR	L	222.00 Ft				
57	WEATHERING	L	7249.00 SqFt				
57	WEATHERING	M	805.00 SqFt				

Network: CTB **Name:** Cut Bank International Airport

Branch: TW **Name:** Taxiway **Use:** TAXIWAY **Area:** 564,566 SqFt

Section: 03 of 8 **From:** - **To:** - **Last Const.:** 7/1/2014

Surface: AAC **Family:** DEFAULT **Zone:** **Category:** **Rank:** P

Area: 20,055 SqFt **Length:** 573 Ft **Width:** 35 Ft

Slabs: **Slab Length:** Ft **Slab Width:** Ft **Joint Length:** Ft

Shoulder: **Street Type:** **Grade:** 0 **Lanes:** 0

Section Comments:

Work Date: 7/31/1991 **Work Type:** New Construction - AC **Code:** NC-AC **Is Major M&R:** True

Work Date: 7/1/2014 **Work Type:** AC- Mill and Overlay **Code:** AC-MO **Is Major M&R:** True

Last Insp. Date: 9/9/2021 **TotalSamples:** 2 **Surveyed:** 2

Conditions: PCI: 83

Inspection Comments:

Sample Number: 01 **Type:** R **Area:** 5492.00 SqFt **PCI:** 85

Sample Comments:

48 L & T CR L 164.00 Ft
57 WEATHERING L 5492.00 SqFt

Sample Number: 02 **Type:** R **Area:** 3842.00 SqFt **PCI:** 80

Sample Comments:

48 L & T CR L 200.00 Ft
57 WEATHERING L 3842.00 SqFt

Network:	CTB	Name:	Cut Bank International Airport						
Branch:	TW	Name:	Taxiway	Use:	TAXIWAY	Area:	564,566 SqFt		
Section:	04	of 8	From:	R/W 31-13	To:	R/W 22-4	Last Const.:	7/31/1991	
Surface:	AC	Family:	DEFAULT	Zone:	CUTB	Category:	D	Rank:	P
Area:	140,863 SqFt	Length:	4,024 Ft	Width:	35 Ft				
Slabs:		Slab Length:	Ft	Slab Width:	Ft	Joint Length:	Ft		
Shoulder:		Street Type:	ACM	Grade:	0	Lanes:	0		
Section Comments:									
Work Date:	7/31/1991	Work Type:			New Construction - Initial	Code:	NU-IN	Is Major M&R:	True
Last Insp. Date:	9/9/2021	TotalSamples:	29	Surveyed:	5				
Conditions:	PCI: 65								
Inspection Comments:									
Sample Number:	05	Type:	R	Area:	4900.00 SqFt	PCI:	65		
Sample Comments:									
48	L & T CR	L	270.00	Ft					
48	L & T CR	M	37.00	Ft					
52	RAVELING	L	2450.00	SqFt					
57	WEATHERING	M	2450.00	SqFt					
Sample Number:	10	Type:	R	Area:	4900.00 SqFt	PCI:	65		
Sample Comments:									
48	L & T CR	L	341.00	Ft					
48	L & T CR	M	38.00	Ft					
52	RAVELING	L	2450.00	SqFt					
57	WEATHERING	M	2450.00	SqFt					
Sample Number:	15	Type:	R	Area:	4900.00 SqFt	PCI:	67		
Sample Comments:									
48	L & T CR	L	412.00	Ft					
52	RAVELING	L	2450.00	SqFt					
57	WEATHERING	M	2450.00	SqFt					
Sample Number:	20	Type:	R	Area:	4900.00 SqFt	PCI:	65		
Sample Comments:									
48	L & T CR	L	256.00	Ft					
48	L & T CR	M	103.00	Ft					
52	RAVELING	L	2450.00	SqFt					
57	WEATHERING	M	2450.00	SqFt					
Sample Number:	25	Type:	R	Area:	4900.00 SqFt	PCI:	65		
Sample Comments:									
48	L & T CR	L	154.00	Ft					
48	L & T CR	M	54.00	Ft					
52	RAVELING	L	2450.00	SqFt					
57	WEATHERING	M	2450.00	SqFt					

Network:	CTB		Name:	Cut Bank International Airport					
Branch:	TW	Name:	Taxiway	Use:	TAXIWAY	Area:	564,566 SqFt		
Section:	05	of 8	From:	T-4	To:	HANGARS	Last Const.:	9/15/2000	
Surface:	AC	Family:	DEFAULT	Zone:		Category:	D	Rank:	P
Area:	104,013 SqFt	Length:	2,798 Ft	Width:	35 Ft				
Slabs:		Slab Length:	Ft	Slab Width:	Ft	Joint Length:	Ft		
Shoulder:		Street Type:	ACM	Grade:	0	Lanes:	0		
Section Comments:									
Work Date:	9/15/2000	Work Type:	New Construction - Initial		Code:	NU-IN	Is Major M&R:	True	
Last Insp. Date:	9/9/2021	TotalSamples:	21	Surveyed:	5				
Conditions:	PCI: 62								
Inspection Comments:									
Sample Number:	02	Type:	R	Area:	5008.00 SqFt	PCI:	57		
Sample Comments:									
48	L & T CR	L	40.00	Ft					
48	L & T CR	M	360.00	Ft					
57	WEATHERING	L	4006.00	SqFt					
57	WEATHERING	M	1002.00	SqFt					
Sample Number:	05	Type:	R	Area:	5005.00 SqFt	PCI:	70		
Sample Comments:									
48	L & T CR	L	50.00	Ft					
48	L & T CR	M	106.00	Ft					
57	WEATHERING	L	4004.00	SqFt					
57	WEATHERING	M	1001.00	SqFt					
Sample Number:	10	Type:	R	Area:	5075.00 SqFt	PCI:	60		
Sample Comments:									
48	L & T CR	L	151.00	Ft					
48	L & T CR	M	242.00	Ft					
57	WEATHERING	L	4060.00	SqFt					
57	WEATHERING	M	1015.00	SqFt					
Sample Number:	16	Type:	R	Area:	5388.00 SqFt	PCI:	58		
Sample Comments:									
48	L & T CR	L	69.00	Ft					
48	L & T CR	M	331.00	Ft					
57	WEATHERING	L	4270.00	SqFt					
57	WEATHERING	M	1068.00	SqFt					
Sample Number:	20	Type:	R	Area:	4725.00 SqFt	PCI:	65		
Sample Comments:									
48	L & T CR	L	25.00	Ft					
48	L & T CR	M	200.00	Ft					
57	WEATHERING	L	3780.00	SqFt					
57	WEATHERING	M	945.00	SqFt					

Network:	CTB		Name:	Cut Bank International Airport			
Branch:	TW	Name:	Taxiway	Use:	TAXIWAY	Area:	564,566 SqFt
Section:	06	of 8	From:	Runway 5 turnaround	To:		Last Const.: 8/1/2007
Surface:	AC	Family:	DEFAULT	Zone:	CUTB	Category:	D
Area:	19,600 SqFt	Length:	560 Ft	Width:	35 Ft	Rank:	P
Slabs:		Slab Length:	Ft	Slab Width:	Ft	Joint Length:	Ft
Shoulder:		Street Type:	ACM	Grade:	0	Lanes:	0
Section Comments:							
Work Date:	8/1/2007	Work Type:	New Construction - Initial	Code:	NU-IN	Is Major M&R:	True
Last Insp. Date:	9/9/2021	TotalSamples:	4	Surveyed:	3		
Conditions:	PCI: 82						
Inspection Comments:							
Sample Number:	01	Type:	R	Area:	5604.00 SqFt	PCI:	84
Sample Comments:							
48	L & T CR	L	66.00	Ft			
57	WEATHERING	L	5043.00	SqFt			
57	WEATHERING	M	560.00	SqFt			
Sample Number:	03	Type:	R	Area:	4895.00 SqFt	PCI:	86
Sample Comments:							
48	L & T CR	L	12.00	Ft			
57	WEATHERING	L	4405.00	SqFt			
57	WEATHERING	M	490.00	SqFt			
Sample Number:	04	Type:	R	Area:	5882.00 SqFt	PCI:	78
Sample Comments:							
48	L & T CR	L	113.00	Ft			
48	L & T CR	M	10.00	Ft			
57	WEATHERING	L	5294.00	SqFt			
57	WEATHERING	M	588.00	SqFt			

Network:	CTB		Name:	Cut Bank International Airport					
Branch:	TW	Name:	Taxiway	Use:	TAXIWAY	Area:	564,566 SqFt		
Section:	11	of 8	From:	APRON A-1	To:	R/W 18-36	Last Const.:	7/1/2014	
Surface:	AAC	Family:	DEFAULT	Zone:	CUTB	Category:	E	Rank:	P
Area:	34,125 SqFt	Length:	910 Ft	Width:	38 Ft				
Slabs:	Slab Length:	Ft	Slab Width:	Ft	Joint Length:	Ft			
Shoulder:	Street Type:	ACM	Grade:	0	Lanes:	0			
Section Comments:									
Work Date:	7/31/1990	Work Type:	New Construction - Initial		Code:	NU-IN	Is Major M&R:	True	
Work Date:	7/1/2014	Work Type:	AC- Mill and Overlay		Code:	AC-MO	Is Major M&R:	True	
Last Insp. Date:	9/9/2021	TotalSamples:	8	Surveyed:	4				
Conditions:	PCI:	88							
Inspection Comments:									
Sample Number:	01	Type:	R	Area:	4328.00 SqFt	PCI:	94		
Sample Comments:									
57	WEATHERING	L		4328.00	SqFt				
Sample Number:	03	Type:	R	Area:	4095.00 SqFt	PCI:	80		
Sample Comments:									
48	L & T CR	L		97.00	Ft				
48	L & T CR	M		12.00	Ft				
50	PATCHING	L		1.00	SqFt				
57	WEATHERING	L		4095.00	SqFt				
Sample Number:	05	Type:	R	Area:	4285.00 SqFt	PCI:	90		
Sample Comments:									
48	L & T CR	L		20.00	Ft				
57	WEATHERING	L		4285.00	SqFt				
Sample Number:	07	Type:	R	Area:	4060.00 SqFt	PCI:	89		
Sample Comments:									
48	L & T CR	L		35.00	Ft				
57	WEATHERING	L		4060.00	SqFt				

Network:	CTB		Name:	Cut Bank International Airport					
Branch:	TW	Name:	Taxiway	Use:	TAXIWAY	Area:	564,566 SqFt		
Section:	21	of 8	From:	INTSECT R/W'S 4-22/13-31	To:	T-4 (OLD R/W 18-36)	Last Const.:	7/1/2014	
Surface:	AAC	Family:	DEFAULT	Zone:	CUTB	Category:	D	Rank:	P
Area:	92,000 SqFt	Length:	2,300 Ft	Width:	40 Ft				
Slabs:	Slab Length:	Ft	Slab Width:	Ft	Joint Length:	Ft			
Shoulder:	Street Type:	ACM	Grade:	0	Lanes:	0			
Section Comments:									
Work Date:	7/31/1990	Work Type:	New Construction - Initial		Code:	NU-IN	Is Major M&R:	True	
Work Date:	7/1/2014	Work Type:	AC- Mill and Overlay		Code:	AC-MO	Is Major M&R:	True	
Last Insp. Date:	9/9/2021	TotalSamples:	18	Surveyed:	5				
Conditions:	PCI: 92								
Inspection Comments:									
Sample Number:	04	Type:	R	Area:	4865.00 SqFt	PCI:	89		
Sample Comments:									
48	L & T CR	L	40.00	Ft					
57	WEATHERING	L	4865.00	SqFt					
Sample Number:	06	Type:	R	Area:	4865.00 SqFt	PCI:	90		
Sample Comments:									
48	L & T CR	L	28.00	Ft					
57	WEATHERING	L	4865.00	SqFt					
Sample Number:	08	Type:	R	Area:	4865.00 SqFt	PCI:	94		
Sample Comments:									
57	WEATHERING	L	4865.00	SqFt					
Sample Number:	10	Type:	R	Area:	4865.00 SqFt	PCI:	94		
Sample Comments:									
57	WEATHERING	L	4865.00	SqFt					
Sample Number:	13	Type:	R	Area:	4865.00 SqFt	PCI:	94		
Sample Comments:									
57	WEATHERING	L	4865.00	SqFt					

Network:	CTB	Name:	Cut Bank International Airport				
Branch:	TW	Name:	Taxiway	Use:	TAXIWAY	Area:	564,566 SqFt
Section:	22	of 8	From:	-	To:	-	Last Const.: 8/1/2007
Surface:	AC	Family:	DEFAULT	Zone:		Category:	Rank: P
Area:	138,705 SqFt	Length:	3,963 Ft	Width:	35 Ft		
Slabs:		Slab Length:	Ft	Slab Width:	Ft	Joint Length:	Ft
Shoulder:		Street Type:		Grade:	0	Lanes:	0
Section Comments:							
Work Date:	8/1/2007	Work Type:	New Construction - Initial	Code:	NU-IN	Is Major M&R:	True
Last Insp. Date:	9/9/2021	TotalSamples:	14	Surveyed:	3		
Conditions:	PCI: 81						
Inspection Comments:							
Sample Number:	01	Type:	R	Area:	5600.00 SqFt	PCI:	81
Sample Comments:							
48	L & T CR	L	139.00	Ft			
57	WEATHERING	L	5040.00	SqFt			
57	WEATHERING	M	560.00	SqFt			
Sample Number:	02	Type:	R	Area:	5105.00 SqFt	PCI:	85
Sample Comments:							
48	L & T CR	L	37.00	Ft			
57	WEATHERING	L	4595.00	SqFt			
57	WEATHERING	M	510.00	SqFt			
Sample Number:	03	Type:	R	Area:	5956.00 SqFt	PCI:	78
Sample Comments:							
45	DEPRESSION	L	2.00	SqFt			
48	L & T CR	L	212.00	Ft			
57	WEATHERING	L	5360.00	SqFt			
57	WEATHERING	M	596.00	SqFt			